


DWG. NO.	096-6199		
D			
REVISIONS			
SYM.	E.C.O.	DATE	APVD.
A			
RELEASED TO PRODUCTION			
B	30141	1/22/25	
REAR ENTRY/DESC.			

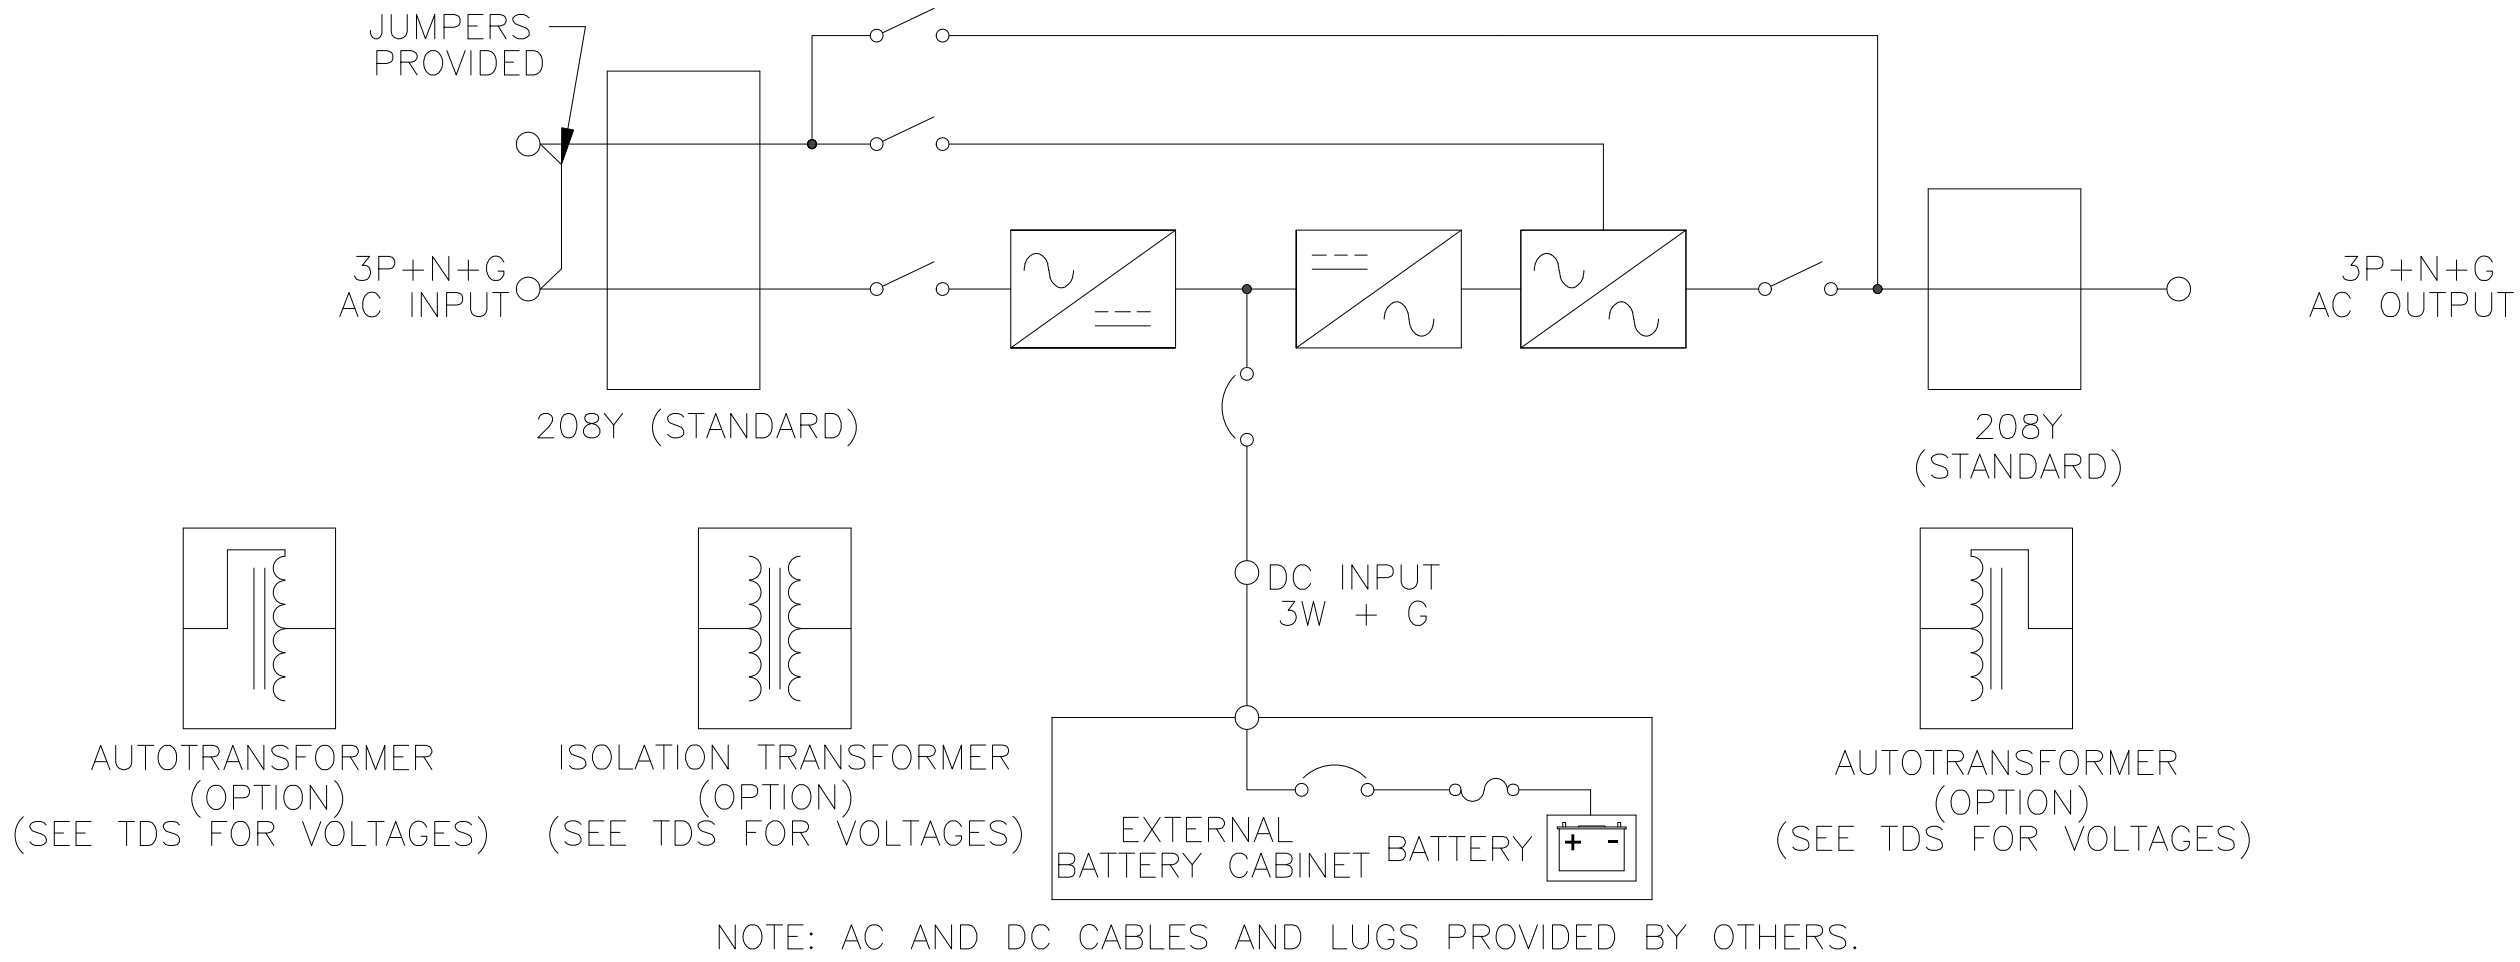

TOP REAR VIEW
UPS

VENTILATION
CLEARANCE

72.44 [1840.0]

40.50 [1028.6]

23.13 [587.4]

REAR VIEW UPS

LEFT SIDE VIEW
UPS

FRONT VIEW UPS

FRONT VIEW UPS
DOORS REMOVED

ENVIRONMENTAL

OPERATING TEMPERATURE: 0 C TO 40° C
ALTITUDE: 0-3300 FEET [1000 METERS]
(WITHOUT DERATING)
RELATIVE HUMIDITY: 0-95%, NON-CONDENSING

SERVICE/VENTILATION CLEARANCES


FROM TOP OF CABINET: 18.00" [457.2MM]
FROM FRONT OF CABINET: 36.00" [914.4MM]
FROM REAR OF CABINET: 0" [0MM]


UL LISTED TO UL 1778, FILE NO.: E191175
UL LISTED TO UL 924 AND OUST

NOTES: SEE SHEETS 3 & 4 FOR BATTERY CABINET
DETAILS


UNLESS OTHERWISE SPECIFIED, TOLERANCE IS ± DECIMALS .XX .010 Holes .005 ANGLES 1° DRAFT 1-1/2°		UNITS IN [mm]		TITLE: SPEC. CONTROL DRAWING STACO E3 UL 924 30 KVA EMERGENCY LIGHTING SYSTEM			
MATERIAL :		ALL DIMENSIONS APPLY AFTER PLATING		DRAWN BY S.FRALEY	DATE 6/26/24	FIRST USED ON	DO NOT SCALE DWG.
The information and design disclosed herein was originated by and is the property of STACO ENERGY PRODUCTS CO., which reserves all patent, proprietary, design, manufacturing, reproduction, use and sale rights thereto, and to any article disclosed therein except to the extent rights are expressly granted to others. The foregoing does not apply to vendor proprietary parts.				CHECKER B.FOX	DATE 7/1/24	WEIGHT APPROX.	CAGE CODE 83008
				ENGINEER B.FOX	DATE 7/1/24	SCALE 1/8	SHEET 1 OF 4
				DWG. NO.	096-6199		
				D			



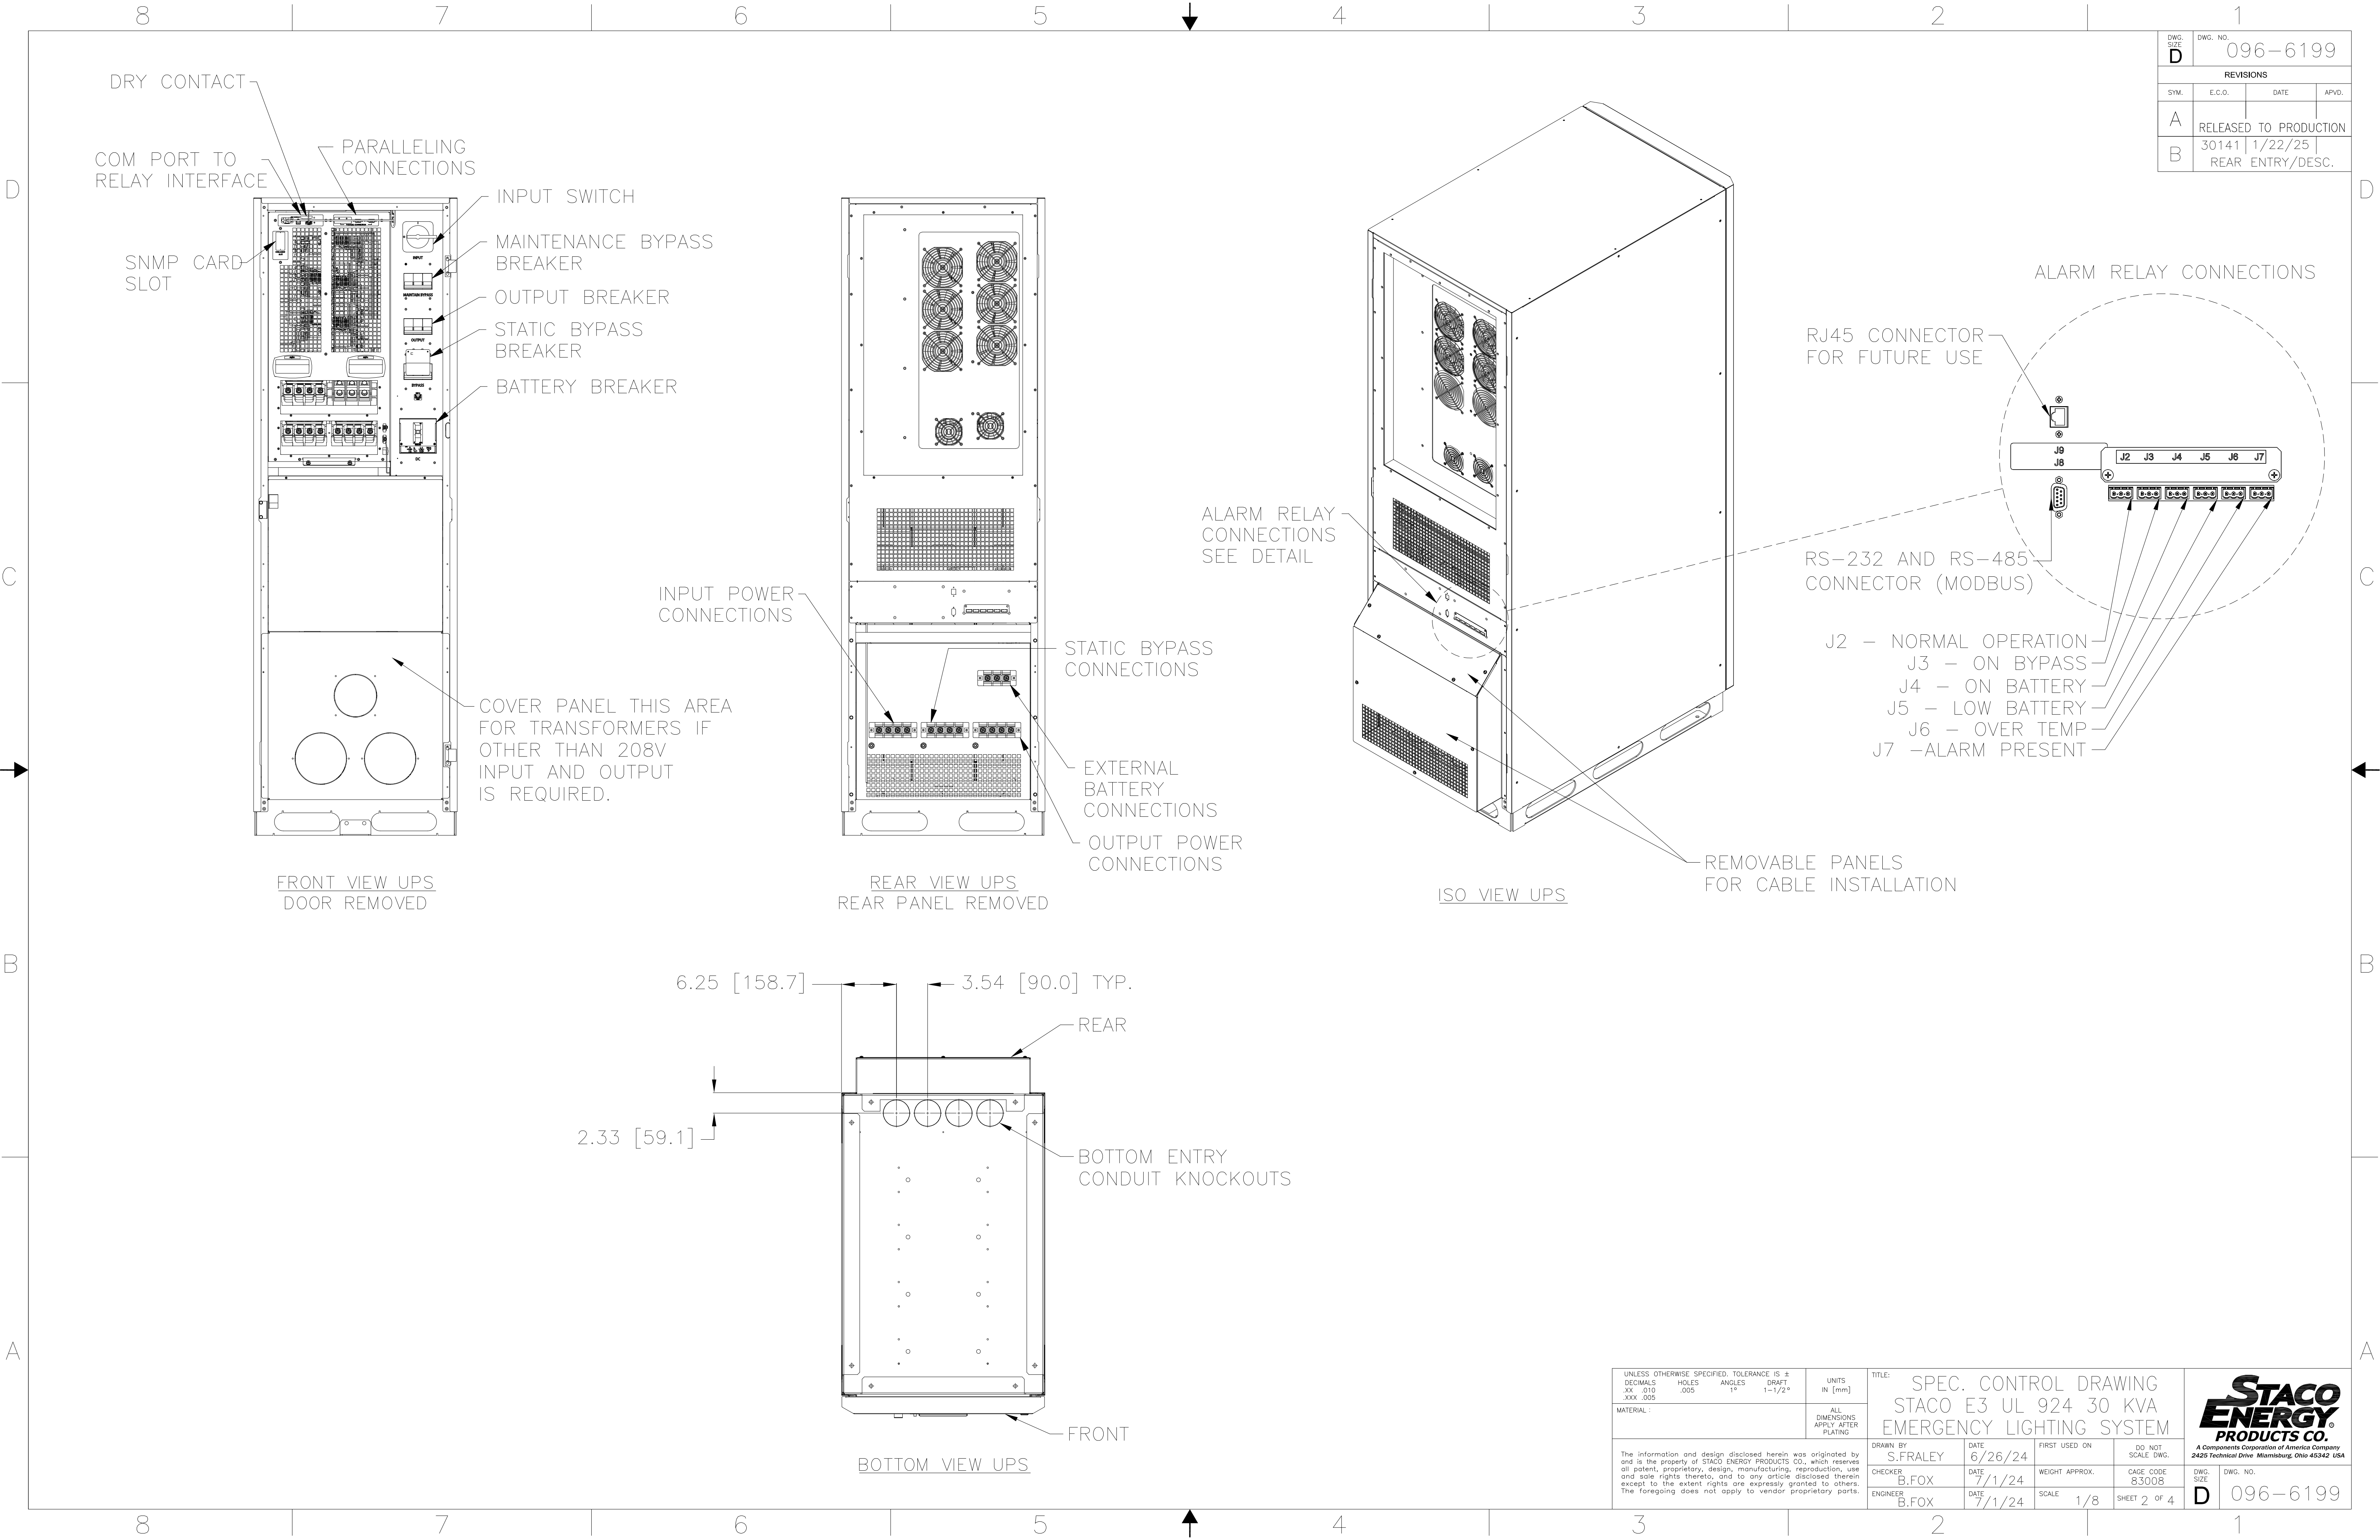

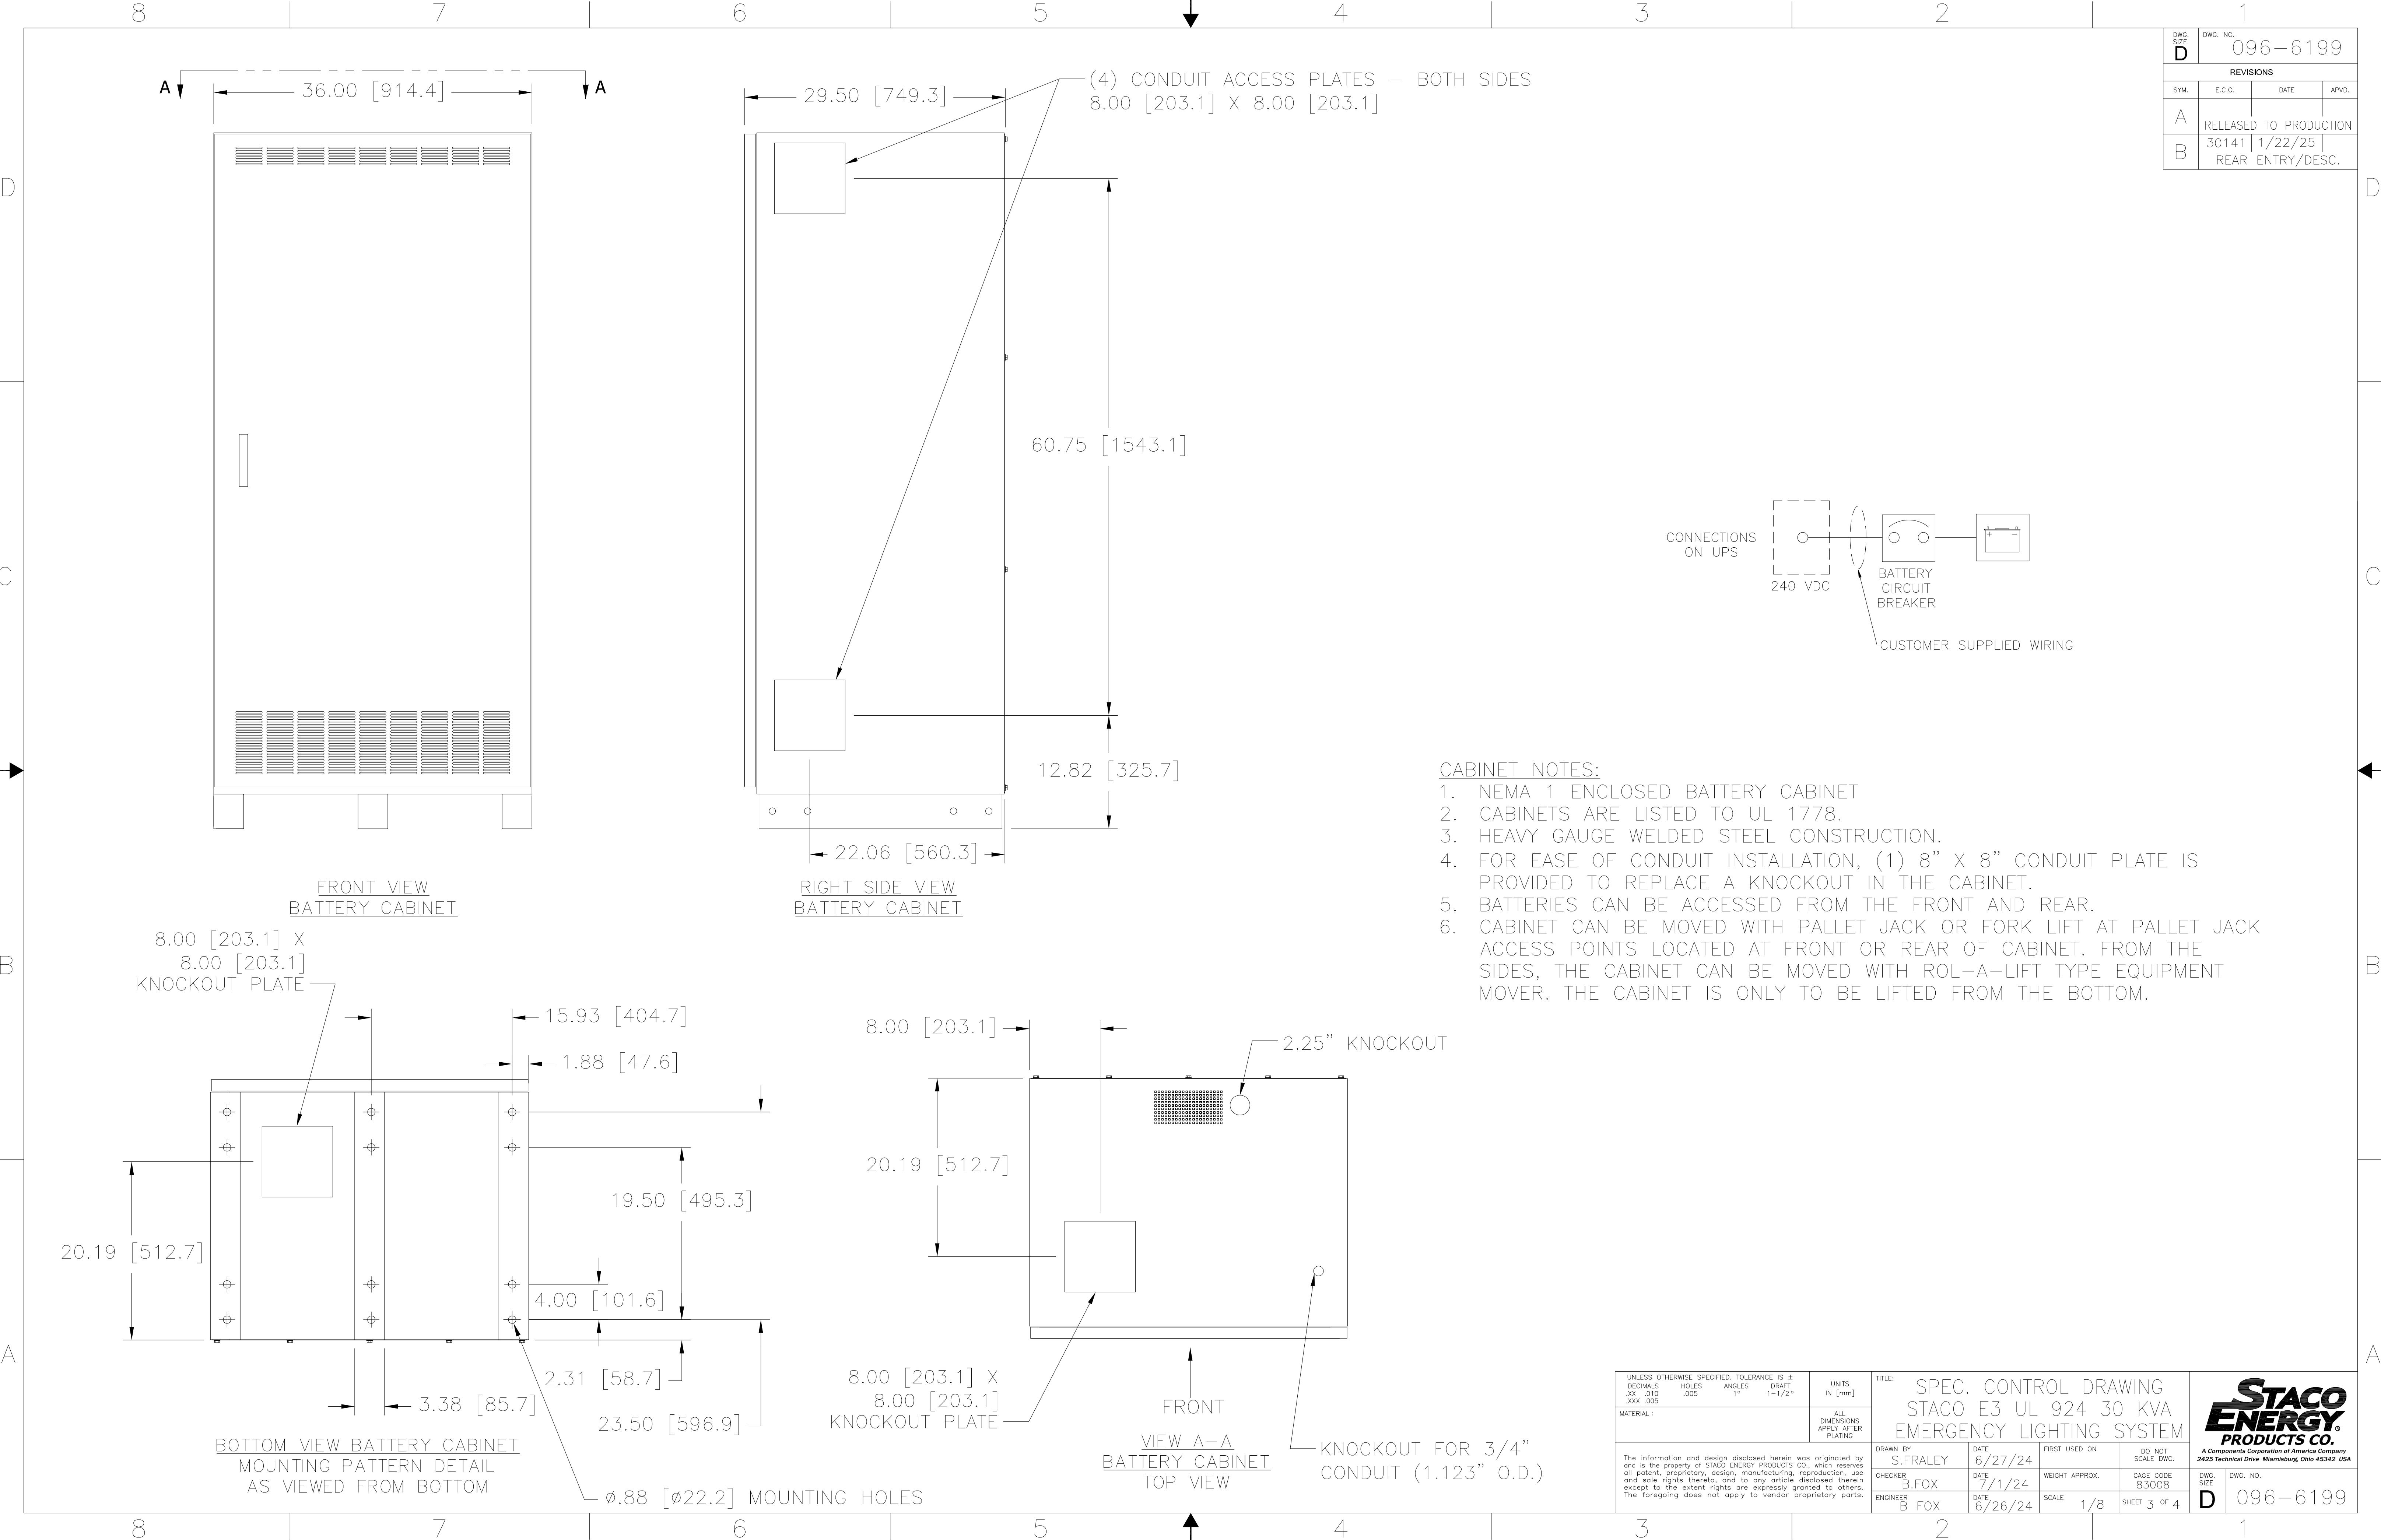

DWG. SIZE D	DWG. NO. 096-6199		
REVISIONS			
SYM.	E.C.O.	DATE	APVD.
A	RELEASED TO PRODUCTION		
B	30141	1/22/25	REAR ENTRY/DESC.

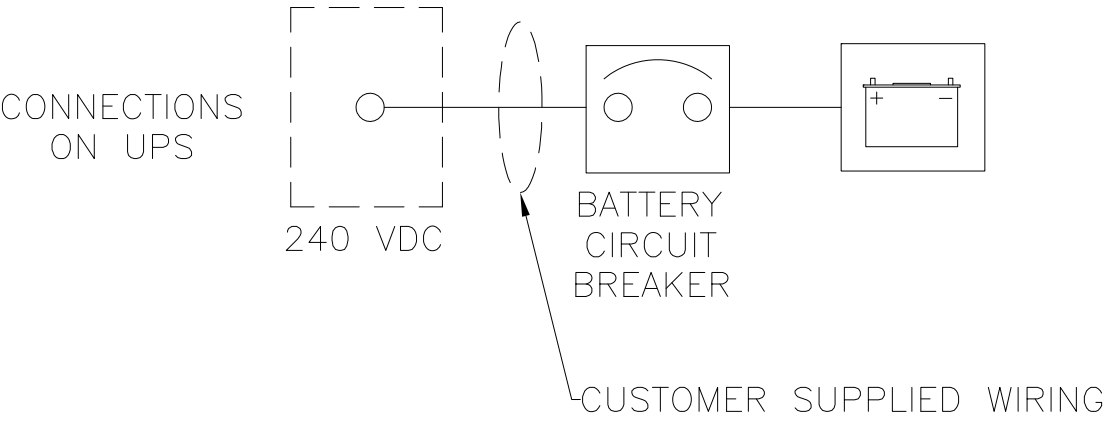

- CABINET NOTES:**
- NEMA 1 ENCLOSED BATTERY CABINET
 - CABINETS ARE LISTED TO UL 1778.
 - HEAVY GAUGE WELDED STEEL CONSTRUCTION.
 - FOR EASE OF CONDUIT INSTALLATION, (1) 8" X 8" CONDUIT PLATE IS PROVIDED TO REPLACE A KNOCKOUT IN THE CABINET.
 - BATTERIES CAN BE ACCESSED FROM THE FRONT AND REAR.
 - CABINET CAN BE MOVED WITH PALLET JACK OR FORK LIFT AT PALLET JACK ACCESS POINTS LOCATED AT FRONT OR REAR OF CABINET. FROM THE SIDES, THE CABINET CAN BE MOVED WITH ROL-A-LIFT TYPE EQUIPMENT MOVER. THE CABINET IS ONLY TO BE LIFTED FROM THE BOTTOM.

UNLESS OTHERWISE SPECIFIED, TOLERANCE IS ± DECIMALS .010 HOLES .005 ANGLES 1° DRAFT 1-1/2° MATERIAL: .XXX .005				TITLE: SPEC. CONTROL DRAWING STACO E3 UL 924 30 KVA EMERGENCY LIGHTING SYSTEM				 A Components Corporation of America Company 2425 Techview Drive Miami, Ohio 45342 USA			
ALL DIMENSIONS APPLY AFTER PLATING				DRAWN BY S.FRALEY DATE 6/27/24 FIRST USED ON DO NOT SCALE DWG.							
				CHECKER B.FOX DATE 7/1/24 WEIGHT APPROX. CASE CODE 83008				DWG. SIZE		DWG. NO.	
				ENGINEER B FOX DATE 6/26/24 SCALE 1/8 SHEET 3 OF 4				D		096-6199	



