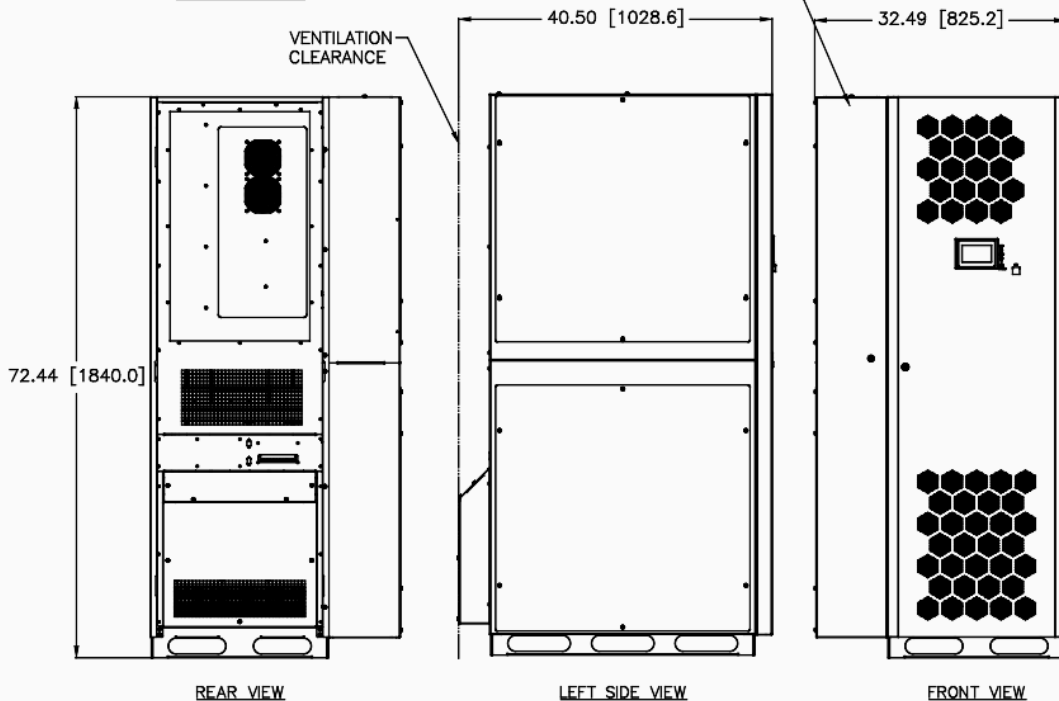
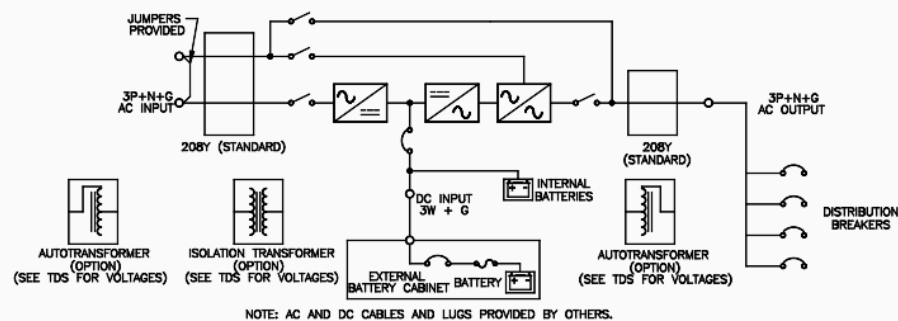
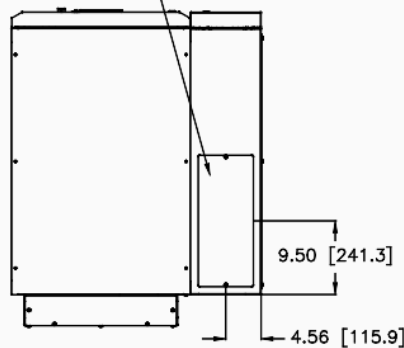


STACO OUST

ENVIRONMENTAL

OPERATING TEMPERATURE: 0 C TO 40° C
ALTITUDE: 0-3300 FEET [1000 METERS]
(WITHOUT DERATING)
RELATIVE HUMIDITY: 0-95% NON-CONDENSING

SERVICE/VENTILATION CLEARANCES


FROM TOP OF CABINET: 18.00" [457.2]
FROM FRONT OF CABINET: 36.00" [914.4]
FROM REAR OF CABINET: 0" [0]

UL LISTED TO UL 1778, FILE NO.: E191175
UL LISTED TO UL 924 AND OUST

[illegible]


REV. NO.	096-6211
REV.	DESCRIPTION
A	RELEASED TO PRODUCTION
B	30141 1/22/25 REAR ENTRY/DESC.

COM PORT TO RELAY INTERFACE
SNMP CARD SLOT
DRY CONTACT
PARALLELING CONNECTIONS
INPUT SWITCH
MAINTENANCE BYPASS BREAKER
OUTPUT BREAKER
STATIC BYPASS BREAKER
BATTERY BREAKER

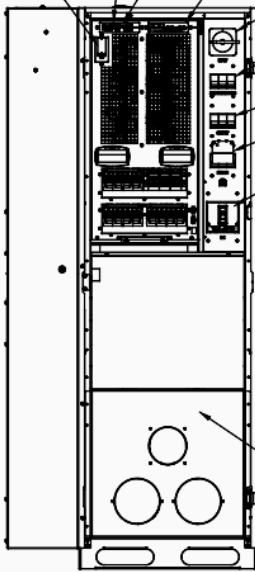

FRONT VIEW
DOOR REMOVED


INPUT POWER CONNECTIONS
COVER PANEL THIS AREA FOR TRANSFORMERS IF OTHER THAN 208V INPUT AND OUTPUT IS REQUIRED.

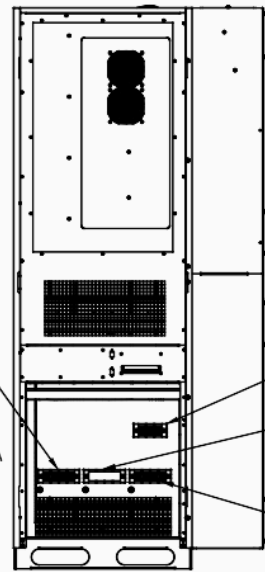

REAR VIEW
REAR PANEL REMOVED

ALARM RELAY CONNECTIONS SEE DETAIL

EXTERNAL BATTERY CONNECTIONS
STATIC BYPASS CONNECTIONS
OUTPUT POWER CONNECTIONS

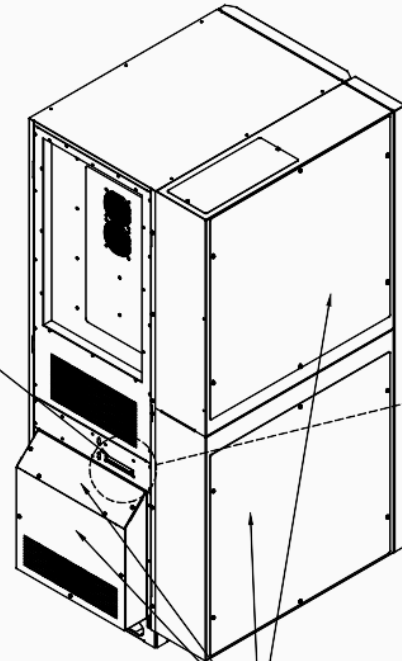

ISO VIEW



REMOVABLE PANELS FOR CABLE INSTALLATION

ALARM RELAY CONNECTIONS

RJ45 CONNECTOR FOR FUTURE USE

RS-232 AND RS-485 CONNECTOR (MODBUS)

- J2 - NORMAL OPERATION
- J3 - ON BYPASS
- J4 - ON BATTERY
- J5 - LOW BATTERY
- J6 - OVER TEMP
- J7 -ALARM PRESENT

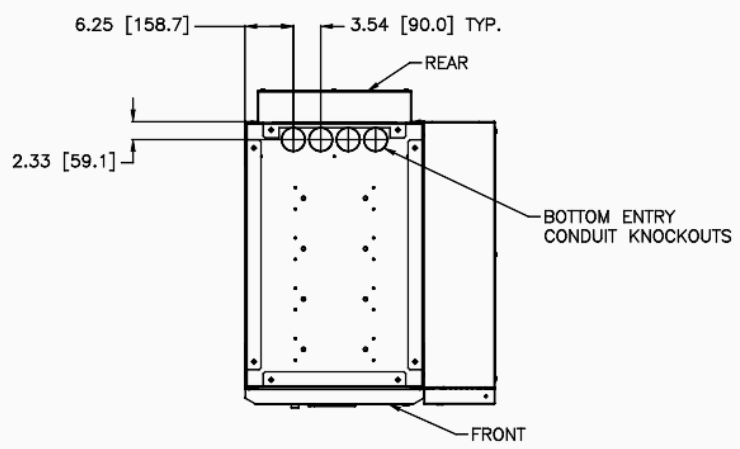

BOTTOM VIEW

SPEC. CONTROL DRAWING STACO E3 OUST 3.5-10 KVA W/DISTRIBUTION					
DESIGNED BY	S. FRALEY	DATE	7/25/24	REV. NO.	096-6211
CHECKED BY		DATE		REV.	
APPROVED BY		DATE		REV.	
SCALE	1/8	SHEET	2 OF 2	REV.	