


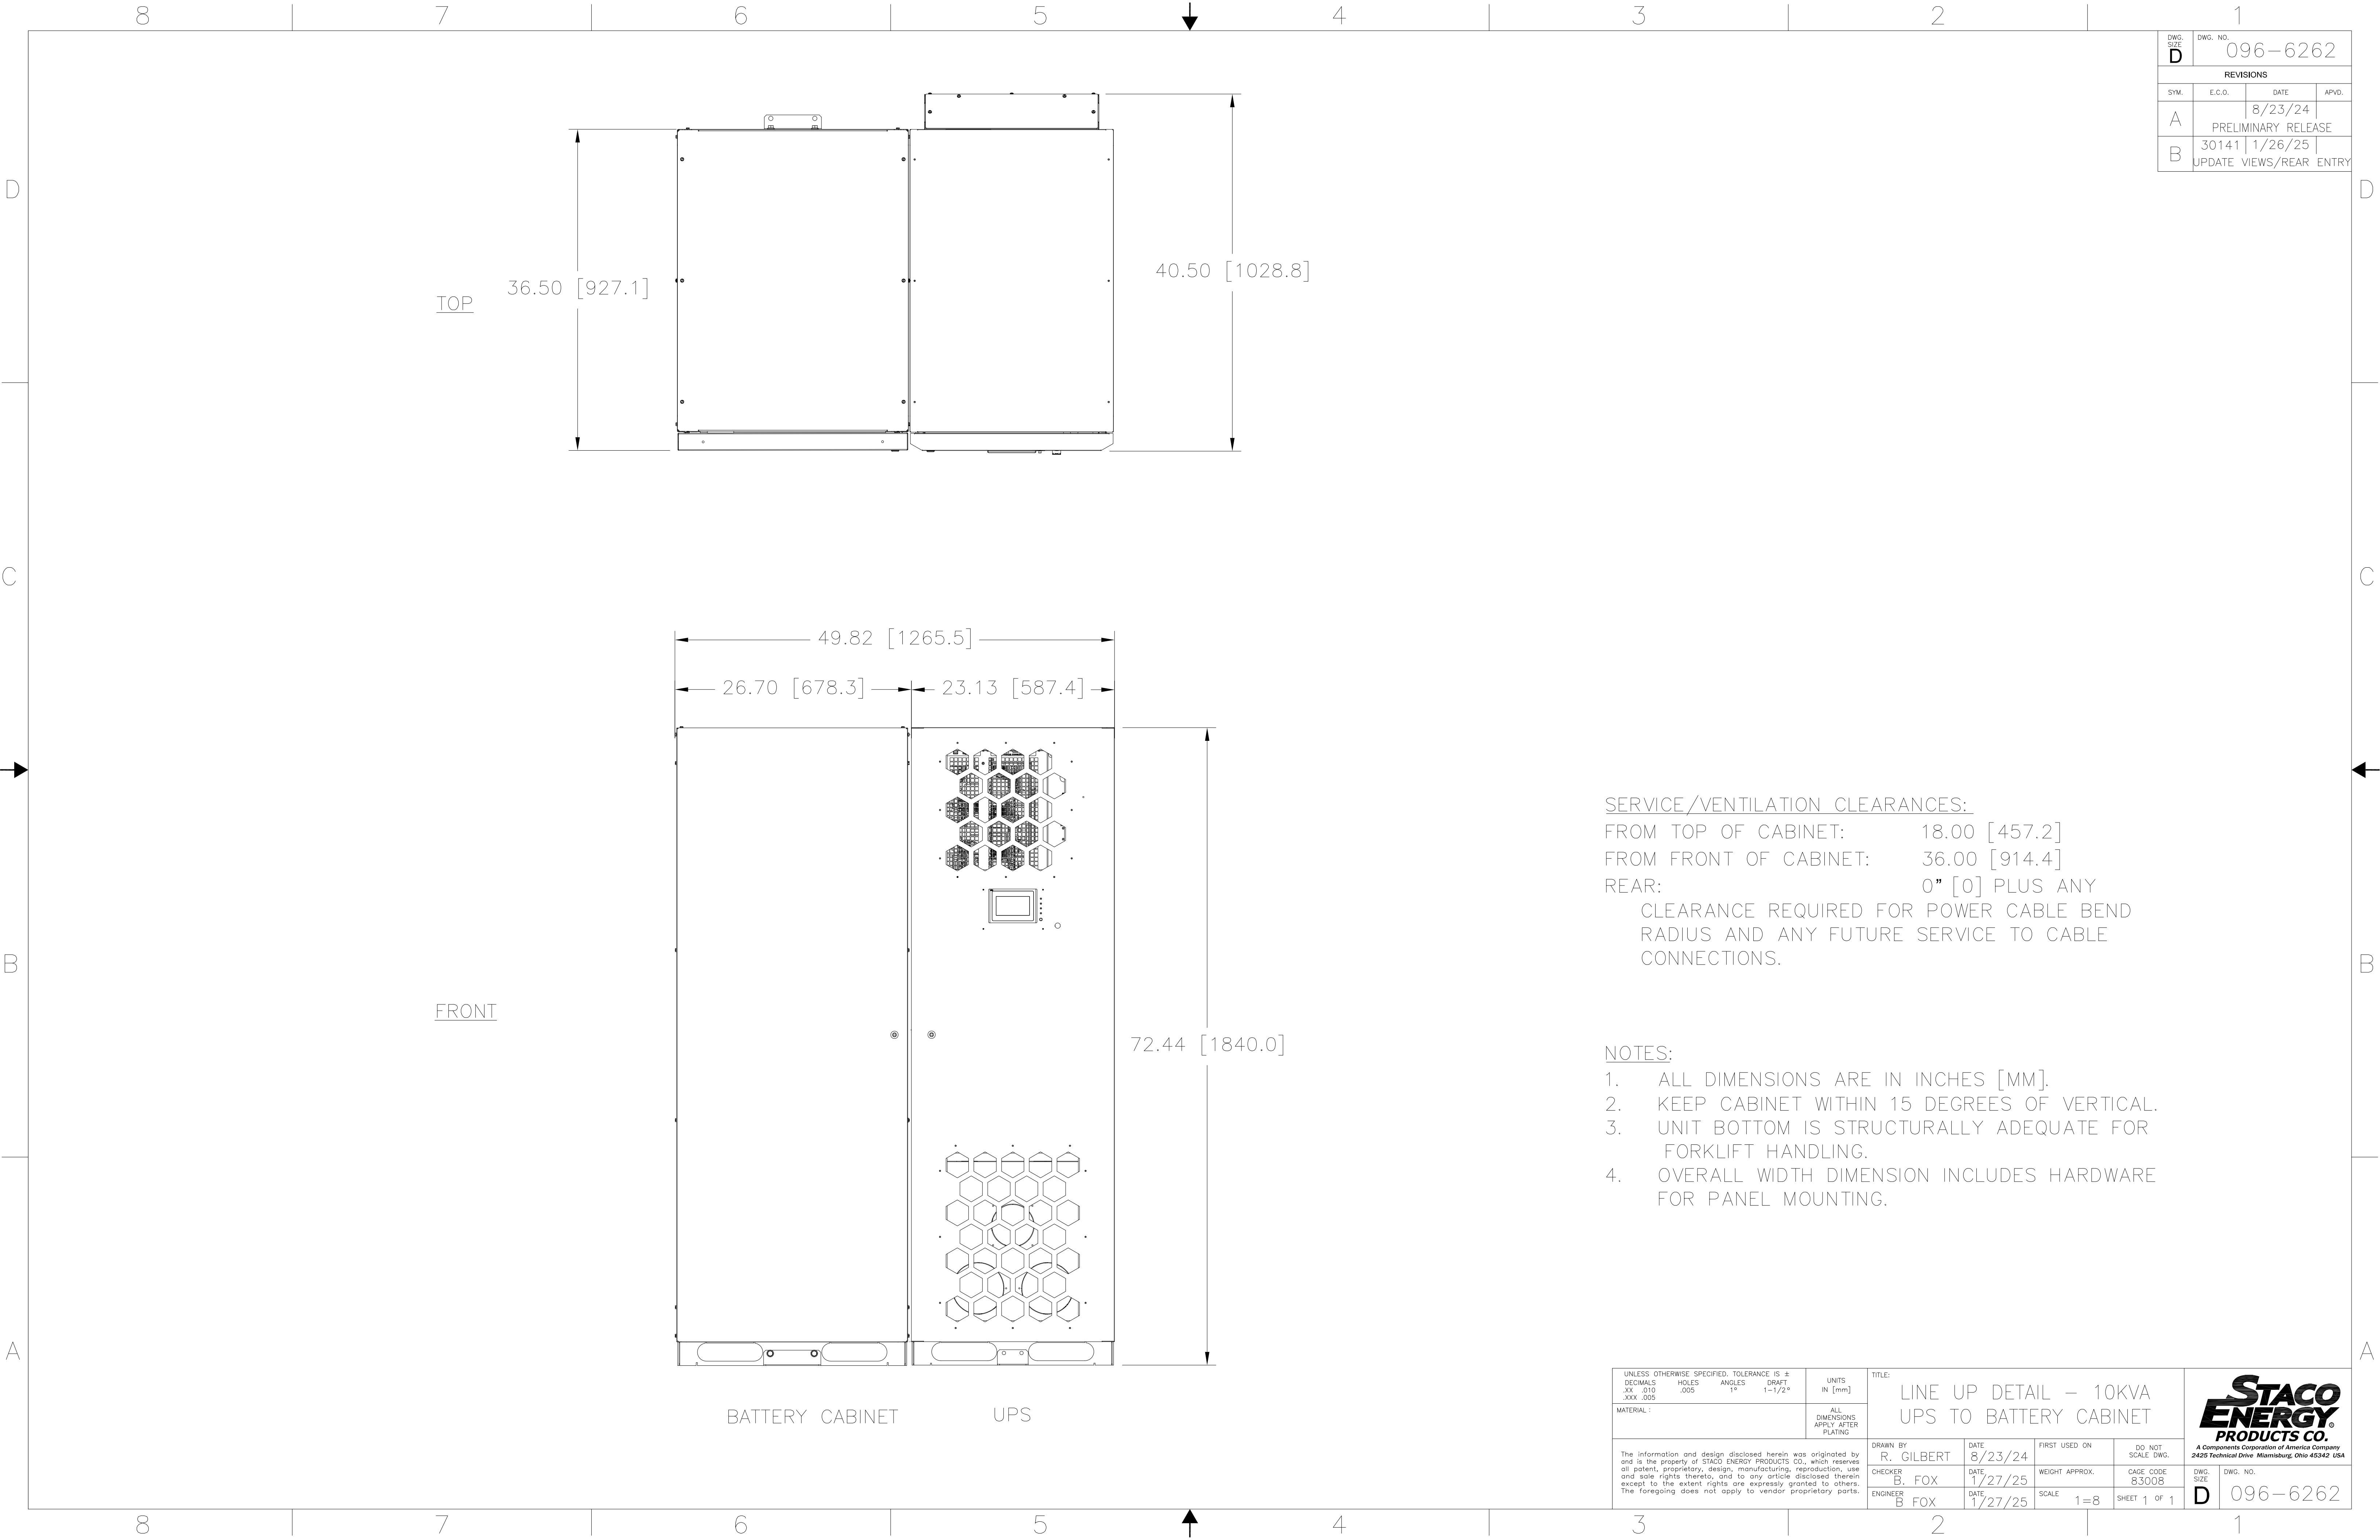

DWG. SIZE D	DWG. NO. 096-6262		
REVISIONS			
SYM.	E.C.O.	DATE	APVD.
A		8/23/24	
PRELIMINARY RELEASE			
B	30141	1/26/25	
UPDATE VIEWS/REAR ENTRY			

SERVICE/VENTILATION CLEARANCES:

FROM TOP OF CABINET: 18.00 [457.2]
FROM FRONT OF CABINET: 36.00 [914.4]
REAR: 0" [0] PLUS ANY
CLEARANCE REQUIRED FOR POWER CABLE BEND
RADIUS AND ANY FUTURE SERVICE TO CABLE
CONNECTIONS.

NOTES:

- ALL DIMENSIONS ARE IN INCHES [MM].
- KEEP CABINET WITHIN 15 DEGREES OF VERTICAL.
- UNIT BOTTOM IS STRUCTURALLY ADEQUATE FOR FORKLIFT HANDLING.
- OVERALL WIDTH DIMENSION INCLUDES HARDWARE FOR PANEL MOUNTING.

UNLESS OTHERWISE SPECIFIED, TOLERANCE IS ±					TITLE:		LINE UP DETAIL – 10KVA UPS TO BATTERY CABINET  STACO ENERGY[®] PRODUCTS CO. A Components Corporation of America Company 2425 Technical Drive Miamisburg, Ohio 45342 USA				
DECIMALS	Holes	ANGLES	DRAFT	UNITS							
.XX .010	.005	1°	1–1/2°	IN [mm]							
MATERIAL :					ALL DIMENSIONS APPLY AFTER PLATING						
The information and design disclosed herein was originated by the is the property of STACO ENERGY PRODUCTS CO., which reserves all patent, proprietary, design, manufacturing, reproduction, use and sale rights thereto, and to any article disclosed therein except to the extent rights are expressly granted to suppliers. The foregoing does not apply to vendor proprietary parts.						DRAWN BY	DATE	FIRST USED ON	DO NOT SCALE DWG.		
						CHECKER	DATE	WEIGHT APPROX.	CAGE CODE	DWG. SIZE	DWG. NO.
						ENGINEER	DATE	SCALE	SHEET		
						R. GILBERT	8/23/24				
						B. FOX	1/27/25		83008	D	096–6262
						B FOX	1/27/25	1=8	1 OF 1		
							</				