DWG. SIZE	DWG. NO.
D	096-6271

REVISIONS

SYM.	E.C.O.	DATE	APVD.
A		8/23/24	
	PRELIMINARY RELEASE		
B	30141	1/26/25	
	UPDATE VIEWS/REAR ENTRY		

TOP

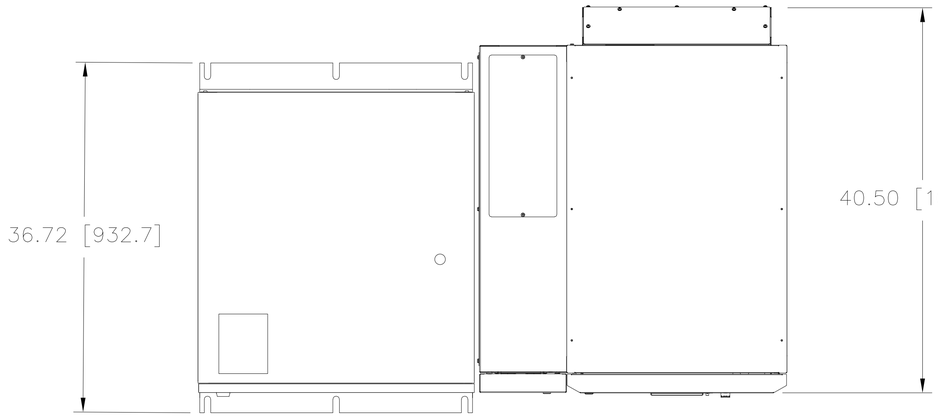

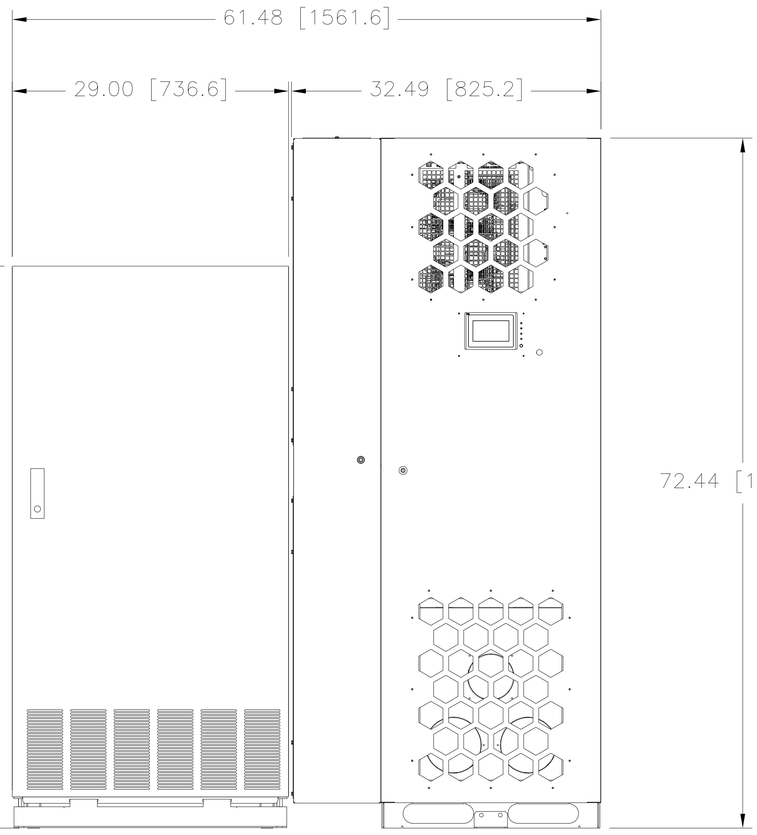

FRONT

BATTERY CABINET UPS WITH DISTRIBUTION

SERVICE/VENTILATION CLEARANCES:

FROM TOP OF CABINET: 18.00 [457.2]
FROM FRONT OF CABINET: 36.00 [914.4]
REAR: 0" [0] PLUS ANY CLEARANCE REQUIRED FOR POWER CABLE BEND RADIUS AND ANY FUTURE SERVICE TO CABLE CONNECTIONS.

NOTES:

1. ALL DIMENSIONS ARE IN INCHES [MM].
2. KEEP CABINET WITHIN 15 DEGREES OF VERTICAL.
3. UNIT BOTTOM IS STRUCTURALLY ADEQUATE FOR FORKLIFT HANDLING.
4. OVERALL WIDTH DIMENSION INCLUDES HARDWARE FOR PANEL MOUNTING.

UNLESS OTHERWISE SPECIFIED, TOLERANCE IS ±
DECIMALS .XX .010 .XXX .005 HOLES .005 ANGLES 1° DRAFT 1-1/2°

UNITS IN [mm]

ALL DIMENSIONS APPLY AFTER PLATING

MATERIAL :

TITLE: UPS WITH BATTERY CABINET AND DISTRIBUTION LINE UP DETAIL – 15KVA

STACO ENERGY® PRODUCTS CO.
A Components Corporation of America Company
2425 Technical Drive Miamisburg, Ohio 45342 USA

The information and design disclosed herein was originated by and is the property of STACO ENERGY PRODUCTS CO., which reserves all patent, proprietary, design, manufacturing, reproduction, use and sale rights thereto, and to any article disclosed therein except to the extent rights are expressly granted to others. The foregoing does not apply to vendor proprietary parts.

DRAWN BY R. GILBERT	DATE 8/23/24	FIRST USED ON	DO NOT SCALE DWG.	
CHECKER B. FOX	DATE 1/27/25	WEIGHT APPROX.	CAGE CODE 83008	DWG. SIZE D
ENGINEER B FOX	DATE 1/27/25	SCALE 1=8	SHEET 1 OF 1	DWG. NO. 096-6271